



TRUNG TÂM THÍ NGHIỆM DỆT MAY
TEXTILE TESTING CENTRE (TTC)

TEST REPORT

Report No. : 484-27-03-20-3/TNV-3
 Date of issue : Apr 9th, 2020

Client: DOXIMEX



Add: 524 Minh Khai Street, Hai Ba Trung District, Hanoi, Vietnam

Date of Sample Receipt: Mar 27th, 2020 Date(s) of performance: From Mar 28th to Apr 8th, 2020

Sample provided and identified by client

Sample Identification: Face Mask, 60 % Cotton, 40 % PE

Test Sample:

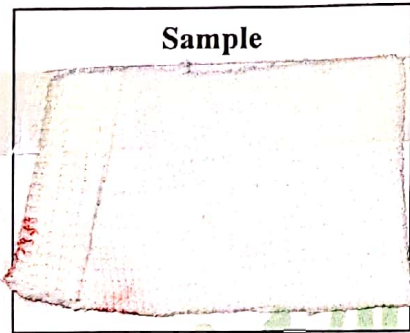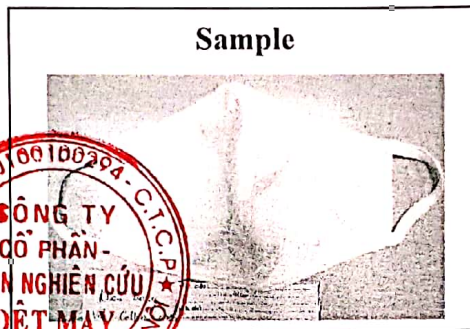

Test results:

No.	Items	Test method	Results		
1	Determination of Antimicrobial Activity - The percent reduction of the organisms (%)	AATCC 100-2012	Escherichia coli ATCC 25922	0 h (B), CFU/ml	1.7×10^5
				24 h (A), CFU/ml	$<1.7 \times 10^2$
				% Reduction (R)	>99.9
			Staphylococcus aureus ATCC 6538	0 h (B), CFU/ml	1.7×10^5
				24 h (A), CFU/ml	$<1.7 \times 10^2$
				% Reduction (R)	>99.9

Remark:

Test specimens were incubated at 37°C for 24 h
 CFU/ml: colony forming units per milliliter
 $R = 100 (B-A) / B$ where:
 A: CFU per milliliter after the 24 h contact time
 B: CFU per milliliter at the "0" contact time

SIGNED FOR AND ON BEHALF OF VTRI



GIÁM ĐỐC TRUNG TÂM THÍ NGHIỆM

THS. Bùi Thị Hải Nam

Results are valid for tested samples provided by applicant only: 10 products.
 Reproduction a part of this Test Report is not allowed without permission written of Textile Testing Centre.
 Client, Sample identification and Manufacturer are introduced at client's requests.



TEST REPORT

Report No. : 484-27-03-20-1/TNV-3
 Date of issue : Apr 9th, 2020

Client: DOXIMEX



Add: 524 Minh Khai Street, Hai Ba Trung District, Hanoi, Vietnam

Date of Sample Receipt: Mar 27th, 2020 Date(s) of performance: From Mar 28th to Apr 8th, 2020

Sample provided and identified by client

Sample Identification: Face Mask, 100 % Cotton

Test Sample:

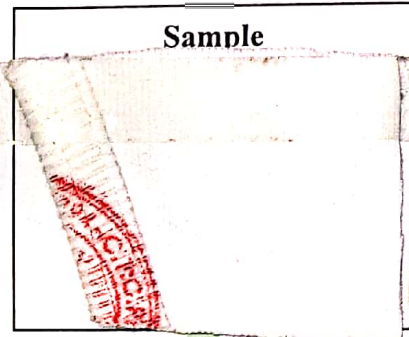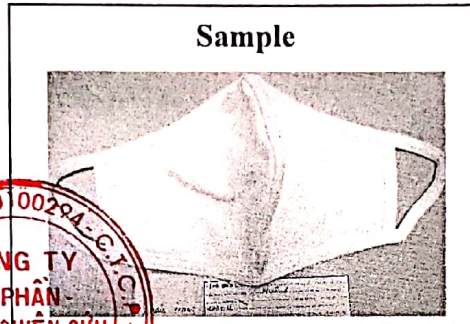

Test results:

No.	Items	Test method	Results		
1	Determination of Antimicrobial Activity - The percent reduction of the organisms (%)	AATCC 100-2012	Escherichia coli ATCC 25922		
			0 h (B), CFU/ml	1.7 x 10 ⁵	
			24 h (A), CFU/ml	<1.7 x 10 ²	
			% Reduction (R)	>99.9	
			Staphylococcus aureus ATCC 6538	0 h (B), CFU/ml	1.7 x 10 ⁵
			24 h (A), CFU/ml	<1.7 x 10 ²	
		% Reduction (R)	>99.9		

Remark:

Test specimens were incubated at 37°C for 24 h
 CFU/ml: colony forming units per milliliter
 $R = 100 (B-A) / B$ where:
 A: CFU per milliliter after the 24 h contact time
 B: CFU per milliliter at the "0" contact time

SIGNED FOR AND ON BEHALF OF VTRI



GIÁM ĐỐC TRUNG TÂM THÍ NGHIỆM

Ths. Bùi Thị Hải Nam



CÔNG TY CỔ PHẦN - VIỆN NGHIÊN CỨU DỆT MAY
VIETNAM TEXTILE RESEARCH INSTITUTE., JSC (VTRI)

Add: 478 Minh Khai, Hai Ba Trung, Hanoi, Vietnam
 Tel : (84-24) 2 215 6167 / 6 681 5577
 Fax: (84-24) 3 862 2867
 Email: lab_tri@viendetmay.org.vn
 trungtamthiNghiem@gmail.com
 Website: www.viendetmay.org.vn

TRUNG TÂM THÍ NGHIỆM DỆT MAY
TEXTILE TESTING CENTRE (TTC)



TEST REPORT

Report No. : 484-27-03-20-2/TNV-3
 Date of issue : Apr 9th, 2020

Client: DOXIMEX



Add: 524 Minh Khai Street, Hai Ba Trung District, Hanoi, Vietnam

Date of Sample Receipt: Mar 27th, 2020 Date(s) of performance: From Mar 28th to Apr 8th, 2020

Sample provided and identified by client

Sample Identification: Face Mask, 95 % Cotton, 5 % Spandex

Test Sample:

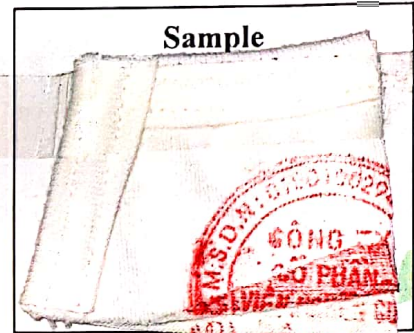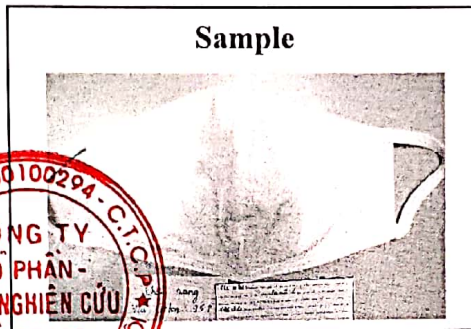

Test results

No.	Items	Test method	Results		
1	Determination of Antimicrobial Activity - The percent reduction of the organisms (%)	AATCC 100-2012	Escherichia coli ATCC 25922		
			0 h (B), CFU/ml	1.7 x 10 ⁵	
			24 h (A), CFU/ml	<1.7 x 10 ²	
			% Reduction (R)	>99.9	
			Staphylococcus aureus ATCC 6538	0 h (B), CFU/ml	1.7 x 10 ⁵
			24 h (A), CFU/ml	<1.7 x 10 ²	
			% Reduction (R)	>99.9	

Remark:

Test specimens were incubated at 37°C for 24 h
 CFU/ml: colony forming units per milliliter
 R = 100 (B-A) / B where:
 A: CFU per milliliter after the 24 h contact time
 B: CFU per milliliter at the "0" contact time

SIGNED FOR AND ON BEHALF OF VTRI



GIÁM ĐỐC TRUNG TÂM THÍ NGHIỆM
TS. Bùi Thị Hải Nam

Results are valid for tested samples provided by applicant only: 10 products.

Reproduction a part of this Test Report is not allowed without permission written of Textile Testing Centre

Client, Sample identification and Manufacturer are introduced at client's requests.